

ALTERNATIVE PLATFORM SIZES

ALTERNATIVE DOOR HANDINGS




CIBES LIFT UK LTD
 HEAD OFFICE
 CHAPEL HOUSE
 LEICESTER ROAD, LOUGHBOROUGH
 LE11 2AF
 TELEPHONE: 01509 436 022

CENTRE OF EXCELLENCE
 UNITS 2 & 3 ENTERPRISE HOUSE, THOMLINSON
 ROAD, HARTLEPOOL,
 TS29 1NS
 TELEPHONE: 01429 426222

PLATFORM SIZE	FOOTPRINT
1000 x 1500mm	1400 x 1625mm
1100 x 1500mm	1500 x 1625mm
1100 x 1600mm	1500 x 1715mm

* SIZE SHOWN ON THIS DRAWING

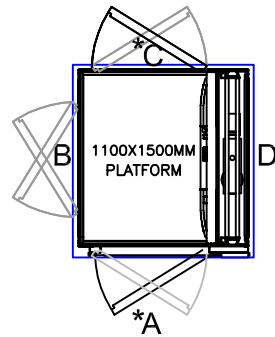

* POSITION SHOWN ON THIS DRAWING

A5000 | 3 STOP | THROUGH ENTRY

GENERAL NOTES

- 1) A 50MM DEEP PIT IS REQUIRED ON SITE FOR THE LIFT TO SIT INTO TO GIVE LEVEL ACCESS AT THE LOWER FLOOR (50MM PIT +6MM/-0MM), IF A PIT IS NOT POSSIBLE THEN THE LIFT MAY SIT ON THE FLOOR AND A RAMP CAN BE PROVIDED.
- 2) WHEN REQUIRED IT MAY BE NECESSARY FOR THE BUILDER TO PROVIDE SUPPORT FOR THE LIFT ON SIDE D.
- 3) THE SUPPORT WALL MUST BE PLUMB TO ±5MM. THE RELATIONSHIP BETWEEN THE LIFT BASE AND THE WALL / FIXING LOCATION IS TO BE PLUMB AND SQUARE -0/+10MM.
- 4) THE FLOOR TO CEILING HEIGHT REQUIRED IS A MINIMUM OF 2250 (WITH PIT - 2300 NO PIT).
- 5) THE STANDARD COLOUR OF THE PLATFORM LIFT SHAFT PANELS IS WHITE RAL 9016 FINISH. OTHER COLOURS ARE AVAILABLE ON REQUEST.
- 6) THE LIFT IS RATED AT 400KG AS STANDARD. 500KG IS ALSO AVAILABLE.
- 7) OTHER LIFT SIZES ARE AVAILABLE. PLEASE CONTACT THE OFFICE FOR OTHER OPTIONS.
- 8) BATTERY EMERGENCY LOWERING IS NOW A STANDARD OPTION FROM THE PLATFORM

ELECTRICS


- SINGLE POWER SUPPLY**
- 1) A PERMANENT 240V 1 PHASE 20 AMP SUPPLY TERMINATING IN A FUSED AND **LOCKABLE ISOLATOR** IS TO BE POSITIONED EXTERNALLY OF THE LIFT ENCLOSURE AND IS TO BE SUPPLIED AND FITTED BY OTHERS WITHIN 500MM OF THE ELECTRICAL COMPARTMENT. IF A TEMPORARY SUPPLY IS PROVIDED AT THE START OF THE INSTALLATION, THIS WOULD STILL NEED TO TERMINATE IN A PERMANENT LOCKABLE ISOLATOR AS NOTED ABOVE. STARTING CURRENT = 14 AMPS
 RUNNING CURRENT = 8 AMPS
- OTHER ELECTRICAL INFORMATION**
- FIRE DRIVE REQUIREMENTS. STANDARD FEATURE
 BT LINE OR SIMILAR ANALOGUE DEDICATED LINE
 INTER-COM OPTION
 GSM LINE OPTION

ELEVATION A

ELEVATION B

ELEVATION C

ELEVATION D

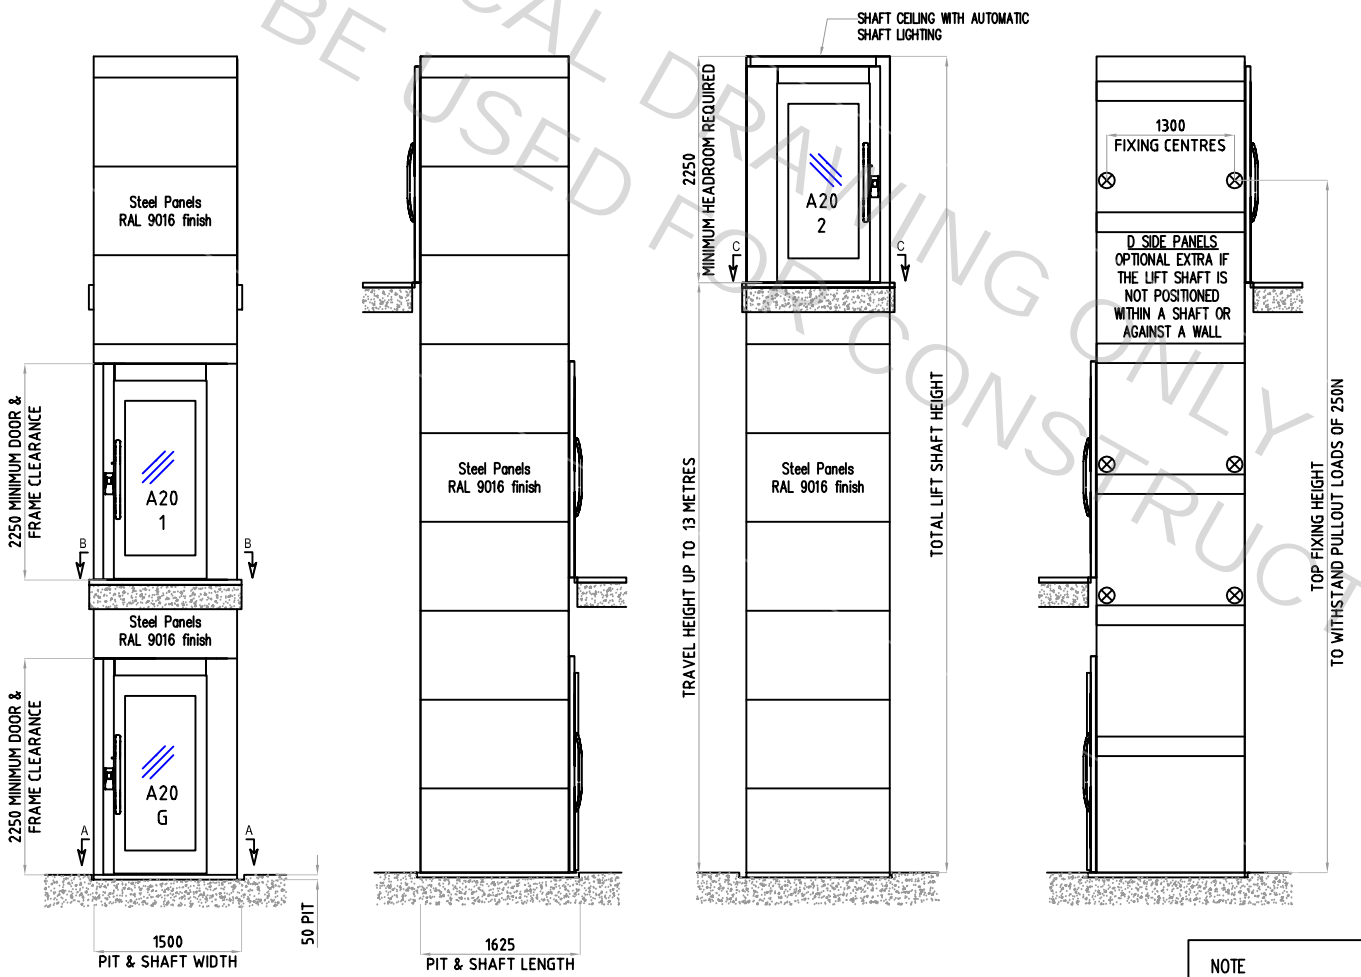

A5000

DO NOT SCALE - IF IN DOUBT ASK

A	30/03/2017	INITIAL DRAWING	DRAWN BY:	CT
ISSUE	DATE	DESCRIPTION	CHECKED BY:	CD

DRAWING TITLE: **A5000 THROUGH ENTRY**

DWG No.	ISSUE:	PAGE:
	A	1 of 2


NOTE
 IF A 50MM PIT IS NOT FEASIBLE THEN A RAMP CAN BE PROVIDED - DETAILS UPON REQUEST

DIMENSIONS IN MM

SCALE
 NTS


A5000 LOADINGS

PLAN VIEW

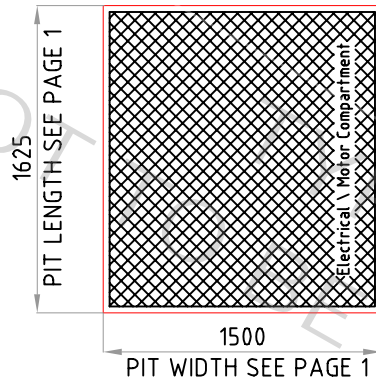


FLOOR LOADING IN THIS AREA:
8.3 KN/M² CONTAINED WITHIN SHADED AREA


SECTION A-A

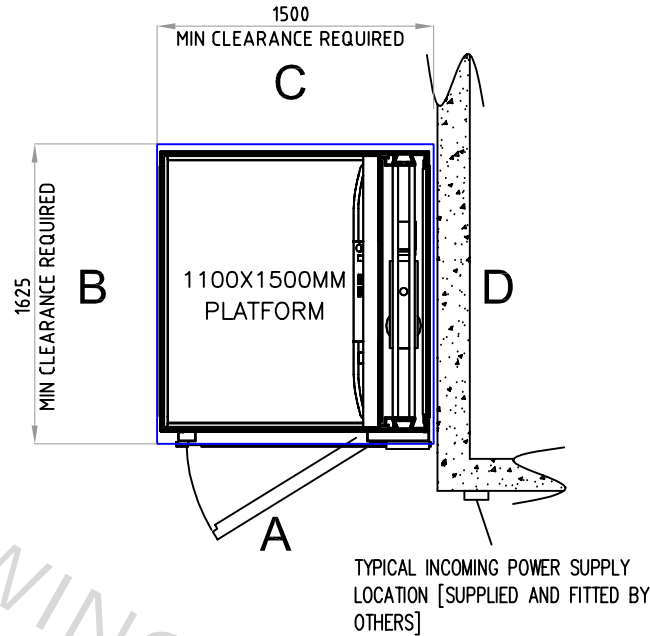

SECTION B-B

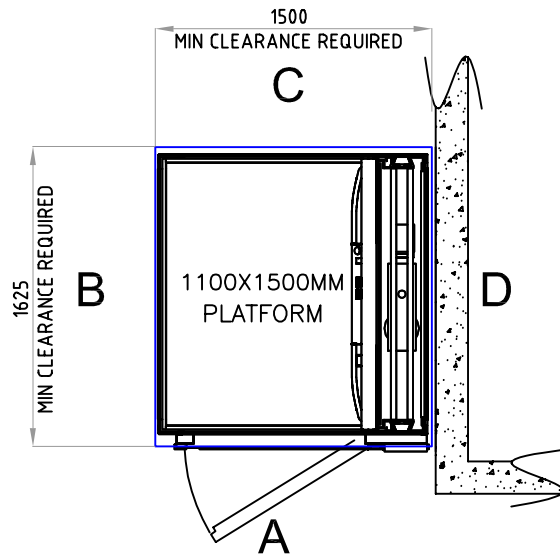

SECTION C-C

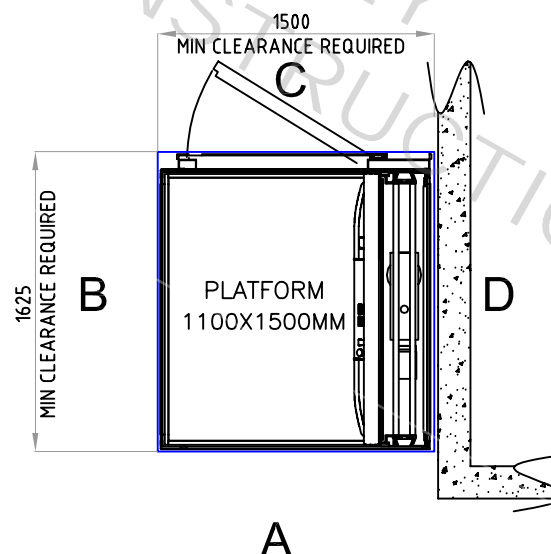

CIBES LIFT UK LTD
 HEAD OFFICE
 CHAPEL HOUSE
 LEICESTER ROAD, LOUGHBOROUGH
 LE11 2AF
 TELEPHONE: 01509 436 022
CENTRE OF EXCELLENCE
 UNITS 2 & 3 ENTERPRISE HOUSE, THOMLINSON
 ROAD, HARTLEPOOL,
 TS28 1NS
 TELEPHONE: 01429 426222

GENERAL NOTES

- 1) A 50MM DEEP PIT IS REQUIRED ON SITE FOR THE LIFT TO SIT INTO TO GIVE LEVEL ACCESS AT THE LOWER FLOOR (50MM PIT +6MM/-0MM). IF A PIT IS NOT POSSIBLE THEN THE LIFT MAY SIT ON THE FLOOR AND A RAMP CAN BE PROVIDED.
- 2) WHEN REQUIRED IT MAY BE NECESSARY FOR THE BUILDER TO PROVIDE SUPPORT FOR THE LIFT ON SIDE D.
- 3) THE SUPPORT WALL MUST BE PLUMB TO ±5MM. THE RELATIONSHIP BETWEEN THE LIFT BASE AND THE WALL / FIXING LOCATION IS TO BE PLUMB AND SQUARE -0/+10MM.
- 4) THE FLOOR TO CEILING HEIGHT REQUIRED IS A MINIMUM OF 2250 (WITH PIT - 2300 NO PIT).
- 5) THE STANDARD COLOUR OF THE PLATFORM LIFT SHAFT PANELS IS WHITE RAL 9016 FINISH. OTHER COLOURS ARE AVAILABLE ON REQUEST.
- 6) THE LIFT IS RATED AT 400KG AS STANDARD. 500KG IS ALSO AVAILABLE.
- 7) OTHER LIFT SIZES ARE AVAILABLE. PLEASE CONTACT THE OFFICE FOR OTHER OPTIONS.
- 8) BATTERY EMERGENCY LOWERING IS NOW A STANDARD OPTION FROM THE PLATFORM

ELECTRICS

SINGLE POWER SUPPLY

1) A PERMANENT 240V 1 PHASE 20 AMP SUPPLY TERMINATING IN A FUSED AND **LOCKABLE ISOLATOR** IS TO BE POSITIONED EXTERNALLY OF THE LIFT ENCLOSURE AND IS TO BE SUPPLIED AND FITTED BY OTHERS WITHIN 500MM OF THE ELECTRICAL COMPARTMENT. IF A TEMPORARY SUPPLY IS PROVIDED AT THE START OF THE INSTALLATION, THIS WOULD STILL NEED TO TERMINATE IN A PERMANENT LOCKABLE ISOLATOR AS NOTED ABOVE.
 STARTING CURRENT = 14 AMPS
 RUNNING CURRENT = 8 AMPS

OTHER ELECTRICAL INFORMATION
 FIRE DRIVE REQUIREMENTS, STANDARD FEATURE
 BT LINE OR SIMILAR ANALOGUE DEDICATED LINE
 INTER-COM OPTION
 GSM LINE OPTION

A5000

DO NOT SCALE - IF IN DOUBT ASK

A	30/03/2017	INITIAL DRAWING	DRAWN BY:	CT
ISSUE	DATE	DESCRIPTION	CHECKED BY:	CD

DRAWING TITLE: **A5000 THROUGH ENTRY**

DIMENSIONS IN MM

SCALE
NTS

DWG No.

ISSUE: A

PAGE: 2 of 2